



Installation information:
 The chilled ceiling panels are components for an installation into a ceiling. They do not replace the necessary ceiling supporting structure.
 This applies also for our air guide profiles.

Chilled ceiling panel INDUCOOL


Single element - installation with air guide profile type 1

Maschinenfabrik Gg. Kiefer GmbH
 Heilbronner Strasse 380 - 396
 D-70469 Stuttgart (Feuerbach)
 Tel.(0711)8109-0 FAX 8109-205

Kiefer
 Seit 1877 | Luft- und Klimatechnik

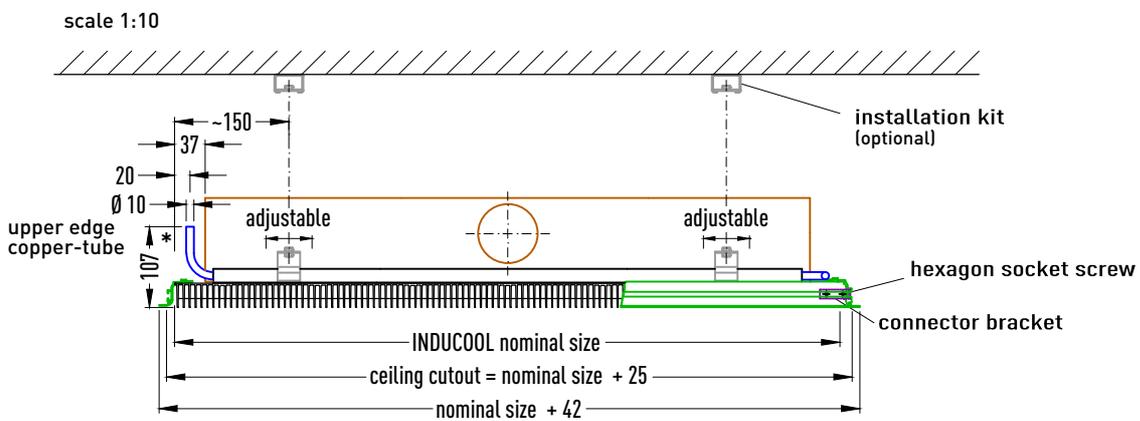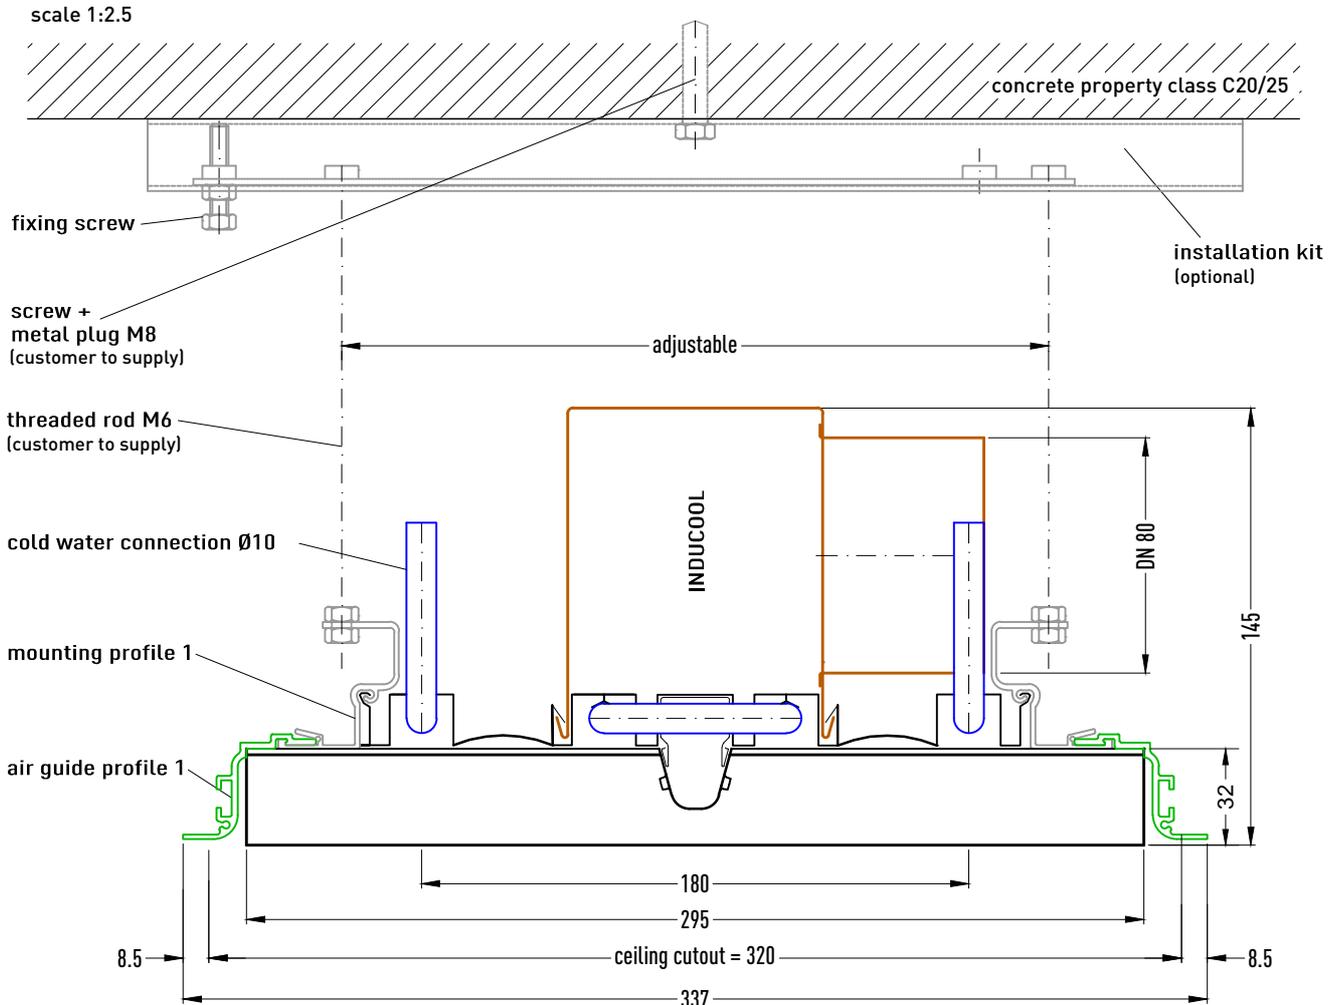

* cold water connection left hand side

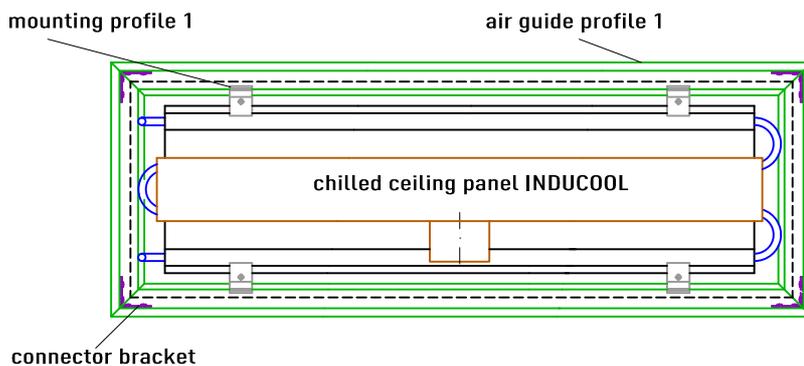

Installation information:

The chilled ceiling panels are components for an installation into a ceiling. They do not replace the necessary ceiling supporting structure.



This applies also for our air guide profiles.

Chilled ceiling panel INDUCOOL


Single element - installation with installation frame type KL 1

Maschinenfabrik Gg. Kiefer GmbH
Heilbronner Strasse 380 - 396
D-70469 Stuttgart (Feuerbach)
Tel. (0711) 8109-0 FAX 8109-205



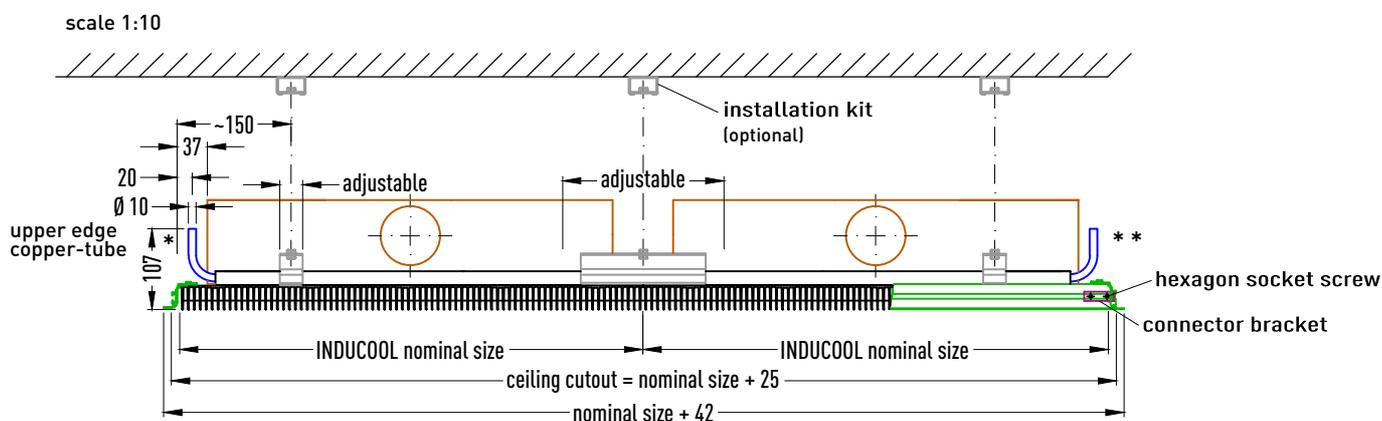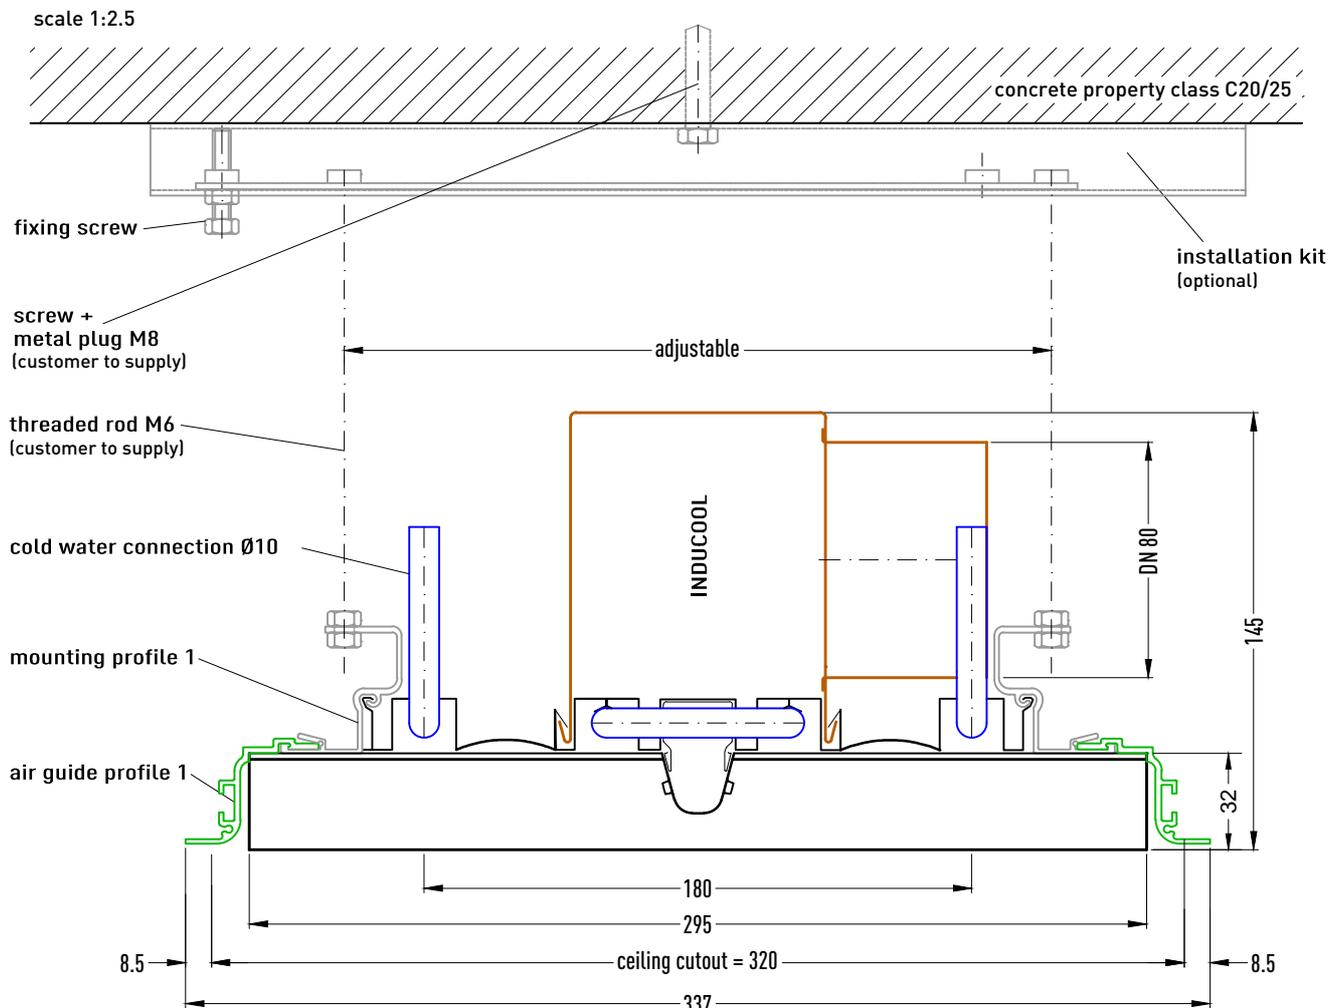




- * cold water connection left hand side
- ** cold water connection right hand side

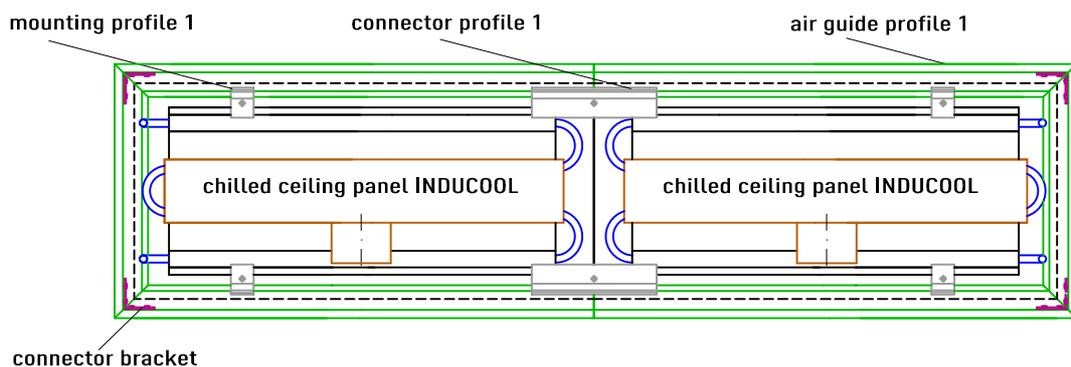

Installation information:
 The chilled ceiling panels are components for an installation into a ceiling. They do not replace the necessary ceiling supporting structure. This applies also for our air guide profiles.

Chilled ceiling panel INDUCOOL

Row-installation with installation frame type KL 1

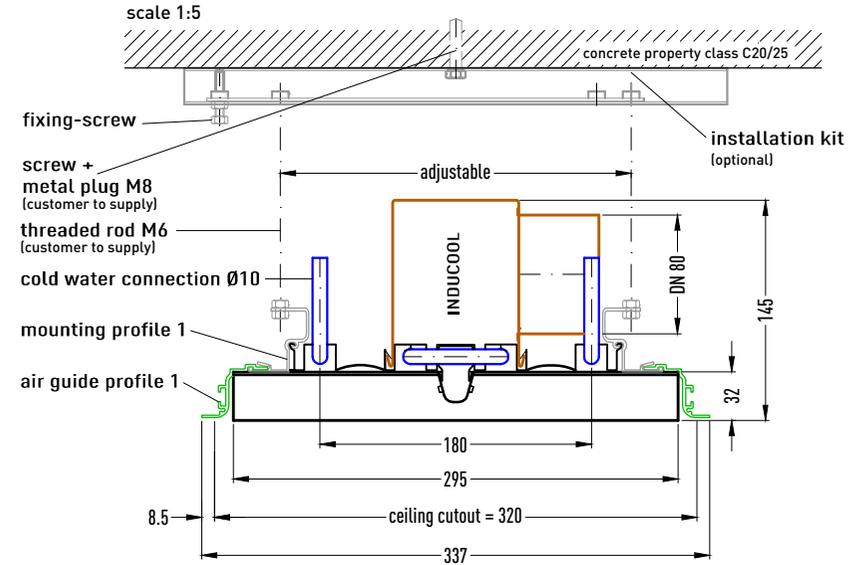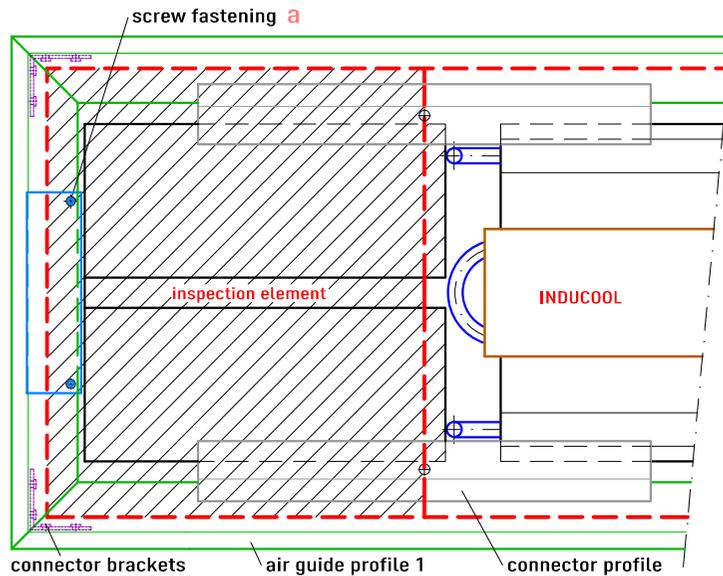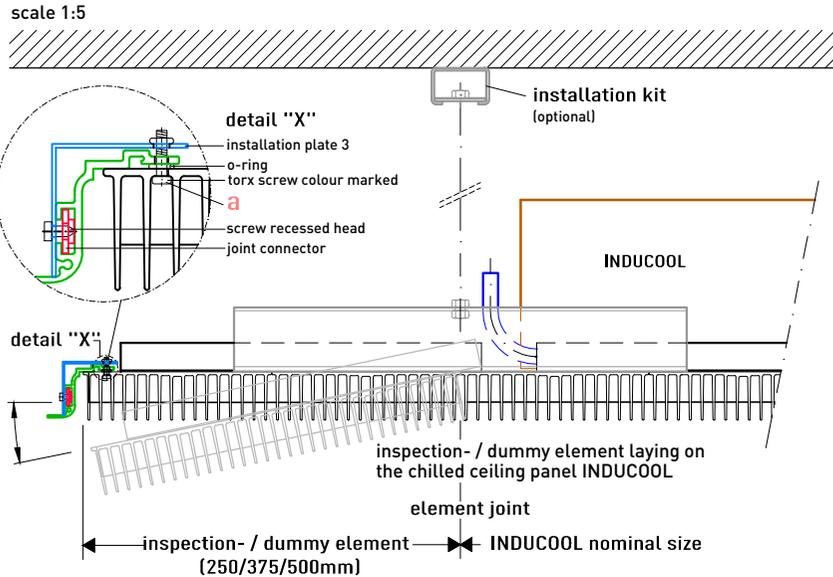

Installation sequence:

- 1.) Mounting INDUCOOL panel.
- 2.) Put on and mounting the frame KL 1 (cons. of air guide profile & connector profile).
- 3.) Fasten installation plate 3 at the frame profile with screw recessed head and joint connector (look at detail "X").
- 4.) Set in inspection element and fasten with the frame KL 1 (screw with black / nickel plated head)
- 5.) Check element joint, if necessary adjust.

To open inspection element:



- a) Loosen marked torx screw with torx screw driver T10. While loosening the 2nd marked torx screw, keep hold of inspection element, lay down afterwards.

Installation information:

The chilled ceiling panels are components for an installation into a ceiling. They do not replace the necessary ceiling supporting structure. This applies also for our air guide profiles.

Chilled ceiling panel INDUCOOL

Inspection- / dummy element -band end- with air guide profile type 1

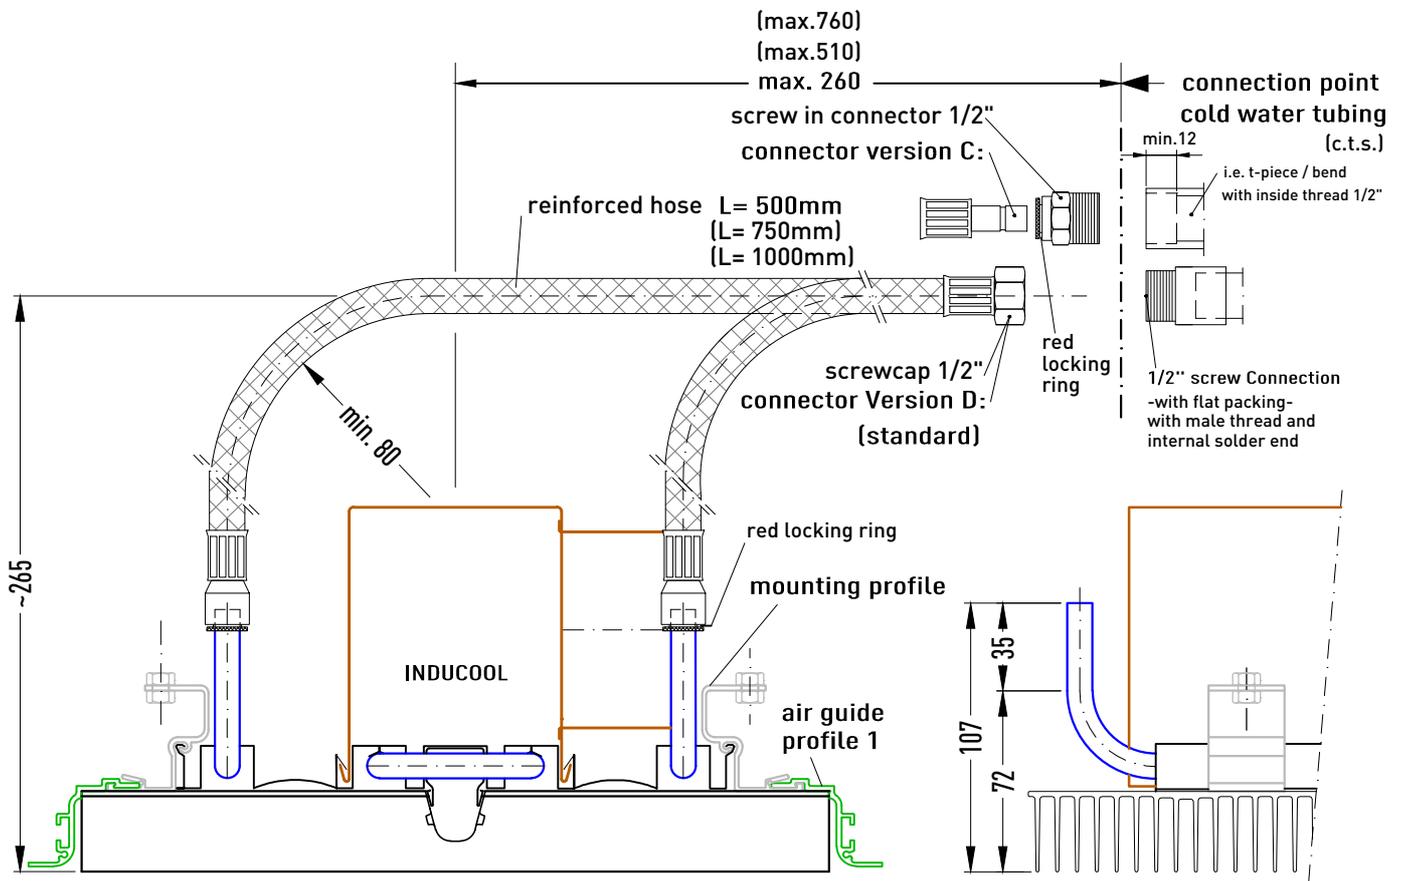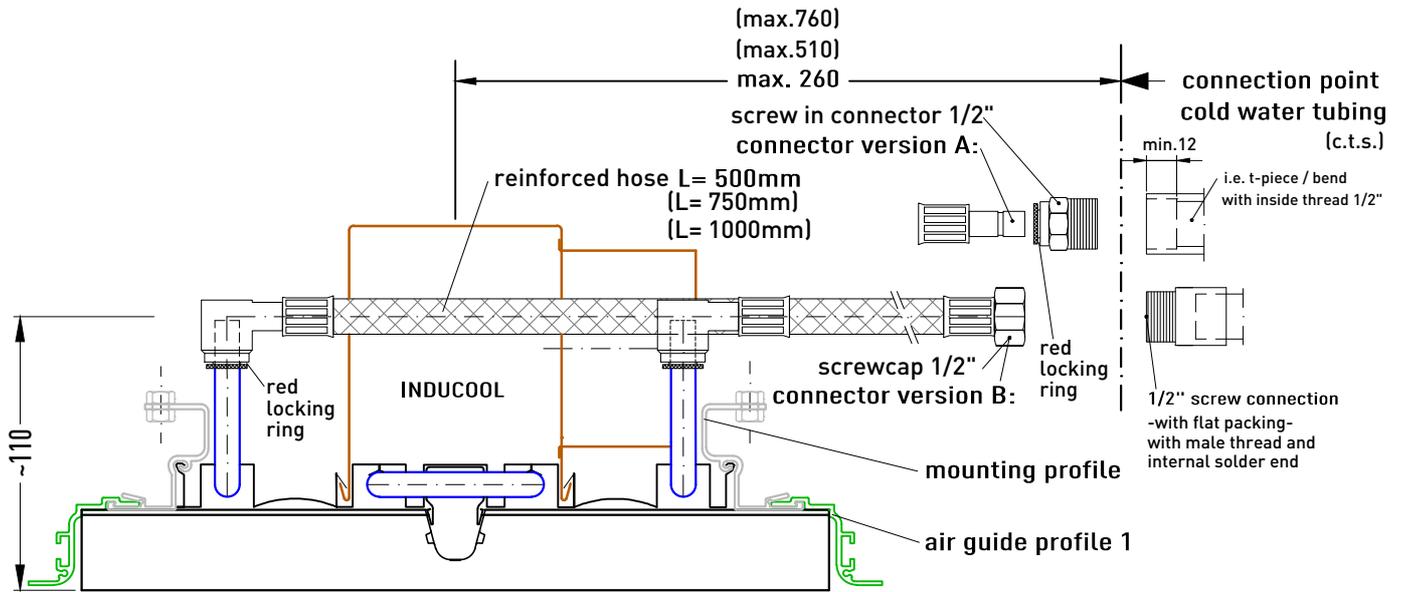

connector version	
D	standard
C	available on inquiry
B	available on inquiry
A	available on inquiry

without scale (modell 1:1)

Chilled ceiling panel INDUCOOL

Cold water connection with reinforced hose

Maschinenfabrik Gg. Kiefer GmbH
Heilbronner Strasse 380 - 396
D-70469 Stuttgart (Feuerbach)
Tel.(0711)8109-0 FAX 8109-205

